WAAS CH 97501 W03A	APP CRS 026°	Rwy ldg 9002 TDZE 4744 Apt Elev 4744

RNAV (GPS) Y RWY 3

IDAHO FALLS RGNL (IDA)

RNP APCH.

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -27°C (-16°F) or above 49°C (121°F).

MISSED APPROACH: Climb to 5200 then climbing left turn to 7500 direct TERRE and hold.

ATIS	SALT LAKE CENTER	IDAHO FALLS TOWER*	GND CON	CLNC DEL	GCO	UNICOM
135.325	128.35 239.25	118.5 (CTAF) L 257.8	121.7	121.7	121.725	122.95

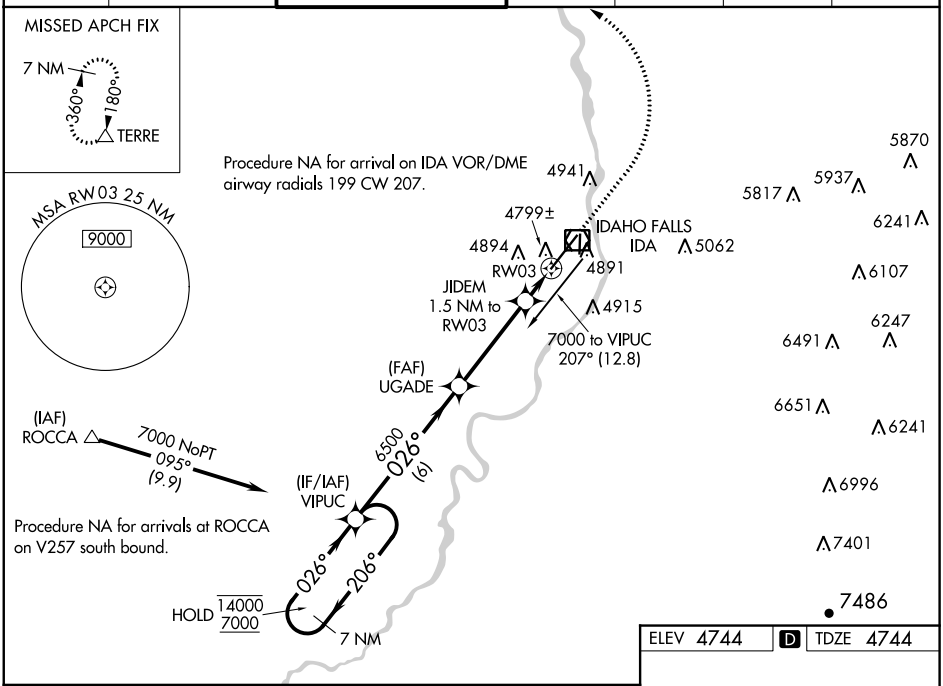

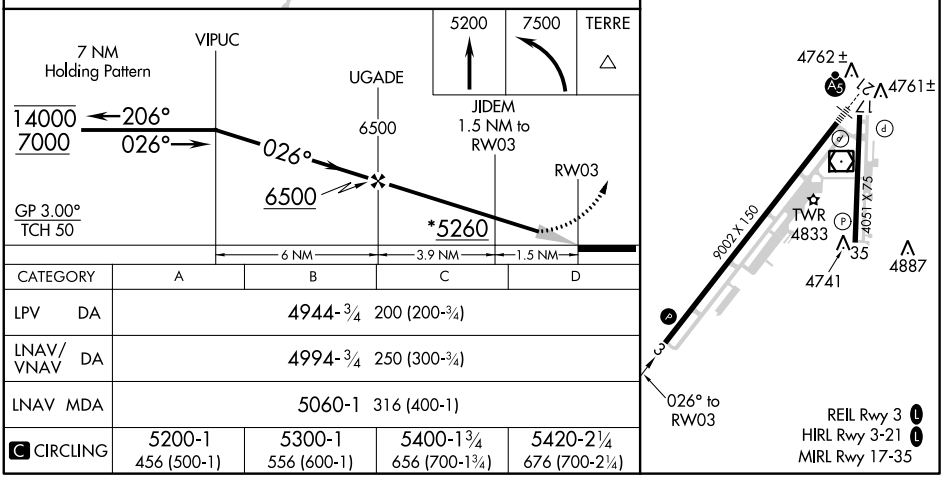

CATEGORY	A	B	C	D
LPV DA	4944-¾ 200 (200-¾)			
LNAV/VNAV DA	4994-¾ 250 (300-¾)			
LNAV MDA	5060-1 316 (400-1)			
C CIRCLING	5200-1 456 (500-1)	5300-1 556 (600-1)	5400-1¾ 656 (700-1¾)	5420-2¼ 676 (700-2¼)

NW-1, 28 JAN 2021 to 25 FEB 2021