RNAV (RNP) Z RWY 8L

DANIEL K INOUYE INTL (HNL) (PHNL)

APP CRS	Rwy Idg	12312
079°	TDZE	13
	Apt Elev	13

RNP AR APCH.

For uncompensated Baro-VNAV systems, procedure NA below 17°C or above 54°C.

MALSR

MISSED APPROACH: Climb to 420 then climbing right turn to 3000 direct ALANA and hold.

D-ATIS	HCF APPROACH	HONOLULU TOWER	GND CON	CLNC DEL
127.9 251.15	118.3 269.0	118.1 257.8 123.9 273.575 (Rwy 8R/26L)	121.9 348.6	121.4 281.4

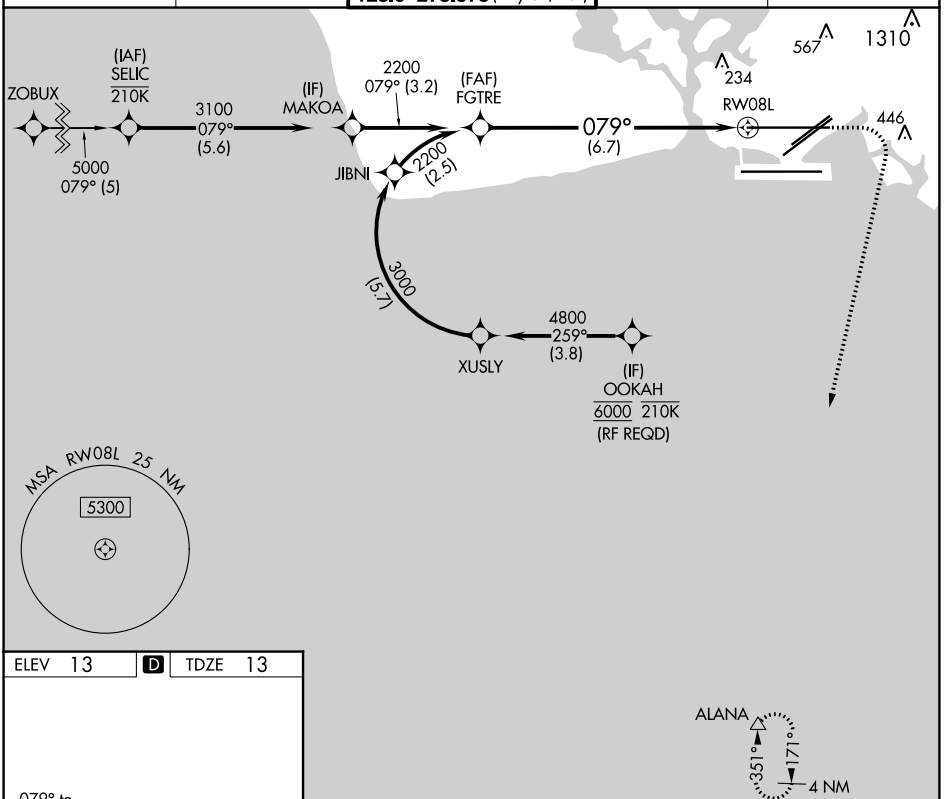

ELEV 13 D TDZE 13

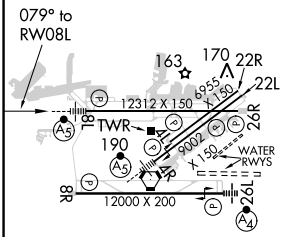

WATER RWYS:
8W-26W 5090 X 300
4W-22W 3000 X 150

REIL Rwys 4L, 8R, 22L, 22R and 26R
HIRL Rwys 4L-22R, 4R-22L, 8L-26R and 8R-26L

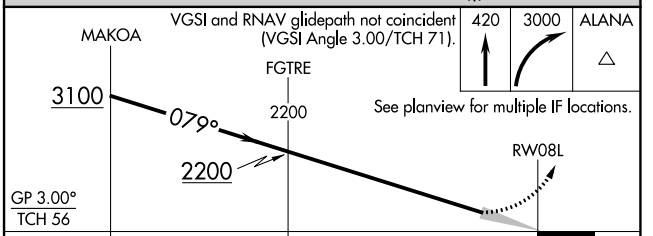

CATEGORY	A	B	C	D
RNP 0.30 DA	343-½ 330 (400-½)			

AUTHORIZATION REQUIRED

PAC, 23 FEB 2023 to 20 APR 2023
PAC, 23 FEB 2023 to 20 APR 2023