

APP CRS  
201°

Rwy Ldg  
TDZE  
Apt Elev

8000  
551  
599

RNAV (RNP) Z RWY 20L


NASHVILLE INTL (BNA)

GPS required. Simultaneous approach authorized with Rwy 20R. Use of FD or AP providing RNAV track guidance required during simultaneous operations. For uncompensated Baro-VNAV systems, procedure NA below -11°C (13°F) or above 54°C (130°F). Inop table does not apply to RNP 0.20. For inop MALSR, increase RNP 0.30 all Cats visibility to 1½.

MALSR

MISSED APPROACH: Climb to 1300 then climbing left turn to 4000 direct CENOP and hold.

D-ATIS 135.1	NASHVILLE APP CON 118.4 360.7	NASHVILLE TOWER 118.6 257.8	GND CON 121.9 348.6	CLNC DEL 126.05	CPDLC
-----------------	----------------------------------	--------------------------------	------------------------	--------------------	-------

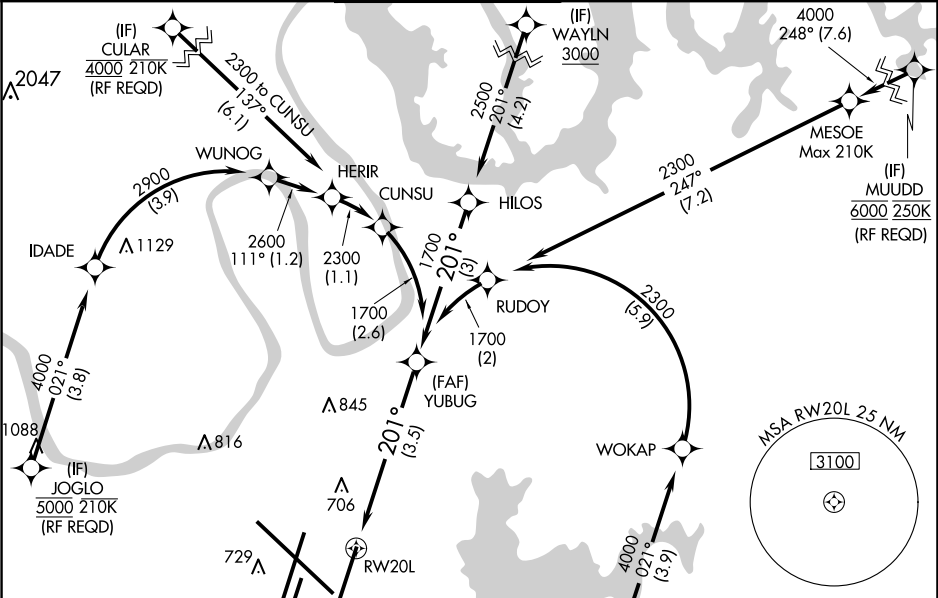

ELEV 599

TDZE 551

1300

4000

CENOP

See planview for multiple IF locations.

RW20L

201°

1700

GP 3.00°

TCH 47

CATEGORY	A	B	C	D
RNP 0.20 DA	810/40		259 (200-¾)	
RNP 0.30 DA	1008/55		457 (400-1)	

AUTHORIZATION REQUIRED

HIRL all Rwys

TDZ/CL Rwys 2L and 2R

REIL Rwys 13, 20C, and 31