

APP CRS  
**031°**

Rwy Ldg  
TDZE  
**35**

Apt Elev  
**46**


**RNAV (RNP) Z RWY 3**  
CHARLESTON AFB/INTL (CHS)

RNP AR APCH.

For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.

MISSED APPROACH: Climb to 3000 direct BAMDE and hold, continue to climb-in-hold to 3000.

D-ATIS <b>124.75</b>	CHARLESTON APP CON <b>120.7 306.925</b>	CHARLESTON TOWER <b>126.0 239.0</b>	GND CON <b>121.9 348.6</b>	CLNC DEL <b>127.325 291.65</b>	CPDLC
-------------------------	--	--	-------------------------------	-----------------------------------	-------

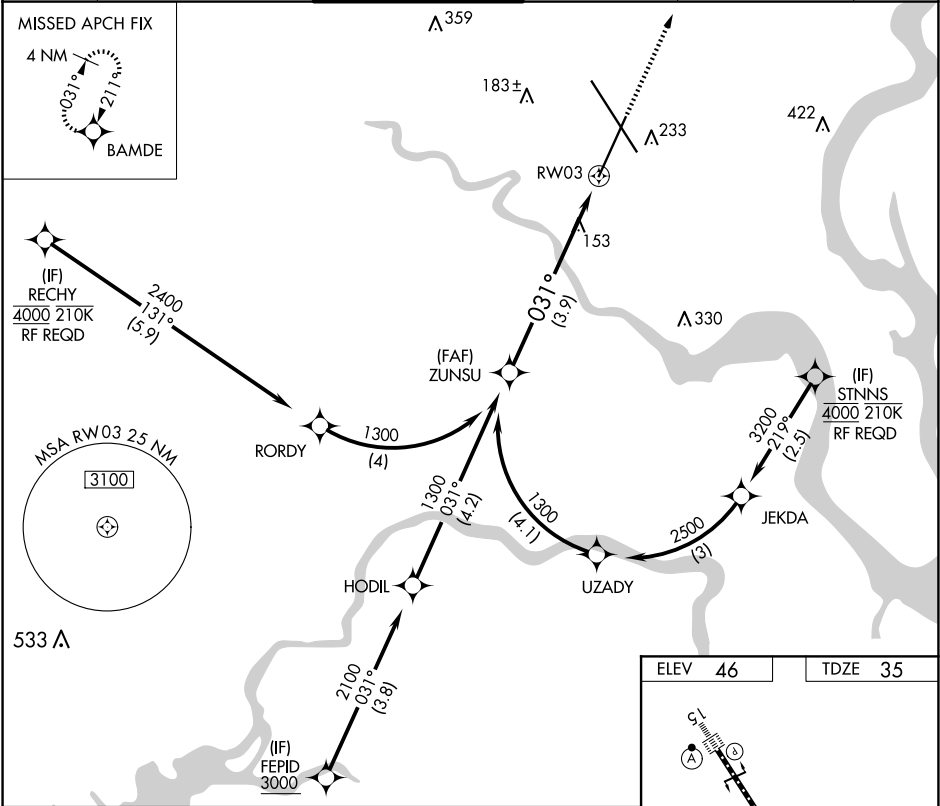

See planview for multiple IF locations.

3000 BAMDE

CATEGORY	A	B	C	D
RNP 0.20 DA	285- <sup>3</sup> / <sub>4</sub> 250 (300- <sup>3</sup> / <sub>4</sub> )			
RNP 0.30 DA	429-1 <sup>1</sup> / <sub>8</sub> 394 (400-1 <sup>1</sup> / <sub>8</sub> )			

**AUTHORIZATION REQUIRED**

ELEV 46 TDZE 35

TDZ/CL Rwy 15  
REIL Rwys 3 and 21  
HIRL Rwys 3-21 and 15-33