




APP CRS <b>036°</b>	Rwy Ldg <b>10001</b> TDZE <b>633</b> Apt Elev <b>645</b>
------------------------	--

RNAV (RNP) W RWY 3R  
DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.			ALSF-2 		MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAUGE and hold.	
 For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.						
D-ATIS <b>133.675</b>	DETROIT APP CON <b>125.15 284.0</b>	METRO TOWER <b>118.4 317.725</b>	GND CON <b>121.8 (NW) 119.45 (NE)</b> <b>132.725 (SW) 119.25 (SE)</b>		CLNC DEL <b>120.65</b>	CPDLC

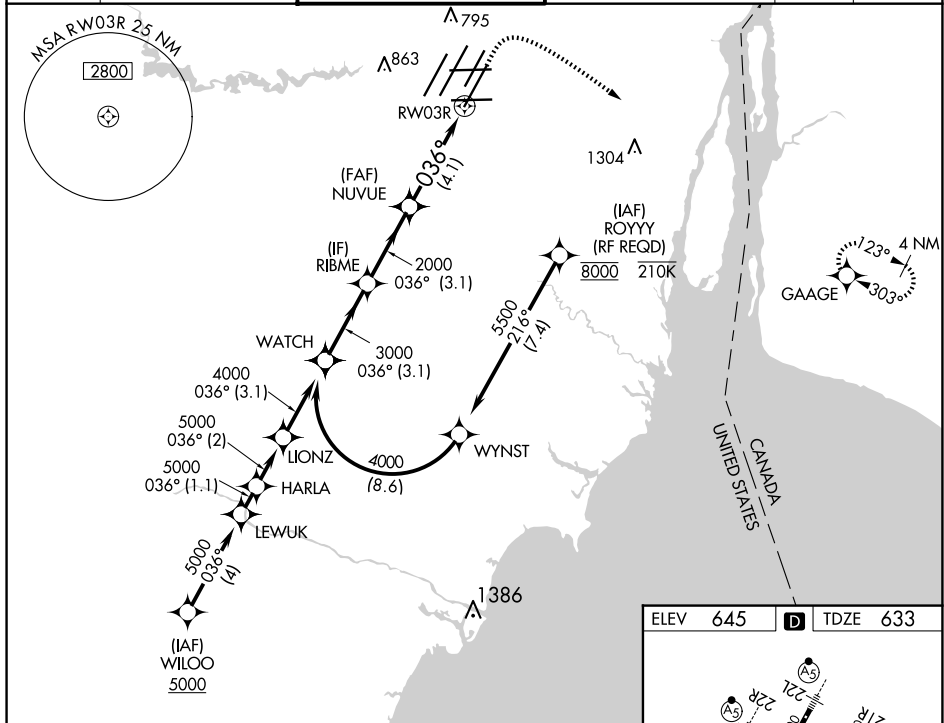

VGSI and RNAV glidepath not coincident  
(VGSI Angle 3.00/TCH 70).

CATEGORY	A			B	C	D
RNP 0.30 DA	1021/35			388 (400-5%)		

**AUTHORIZATION REQUIRED**