

LOC I-TFR <u>108.3</u>	APP CRS 260°	Rwy Ldg TDZE Apt Elev	10496 4659 4729
----------------------------------	------------------------	-----------------------------	--

ILS or LOC RWY 26L


PUEBLO MEML (PUB)

DME required. RADAR required for procedure entry at PYNON.

T DME from PUB VORTAC, simultaneous reception
A of I-TFR and PUB DME required.

MISSED APPROACH: Climb to 7000 on heading 260° and on PUB VORTAC R-259 to OKDEE/PUB 10.6 DME and hold.

ATIS 125.25	DENVER APP CON ★ 120.1 290.5	PUEBLO TOWER ★ 119.1 (CTAF) 0 257.8	GND CON 121.9	CLNC DEL 120.9	UNICOM 122.95
-----------------------	--	---	-------------------------	--------------------------	-------------------------

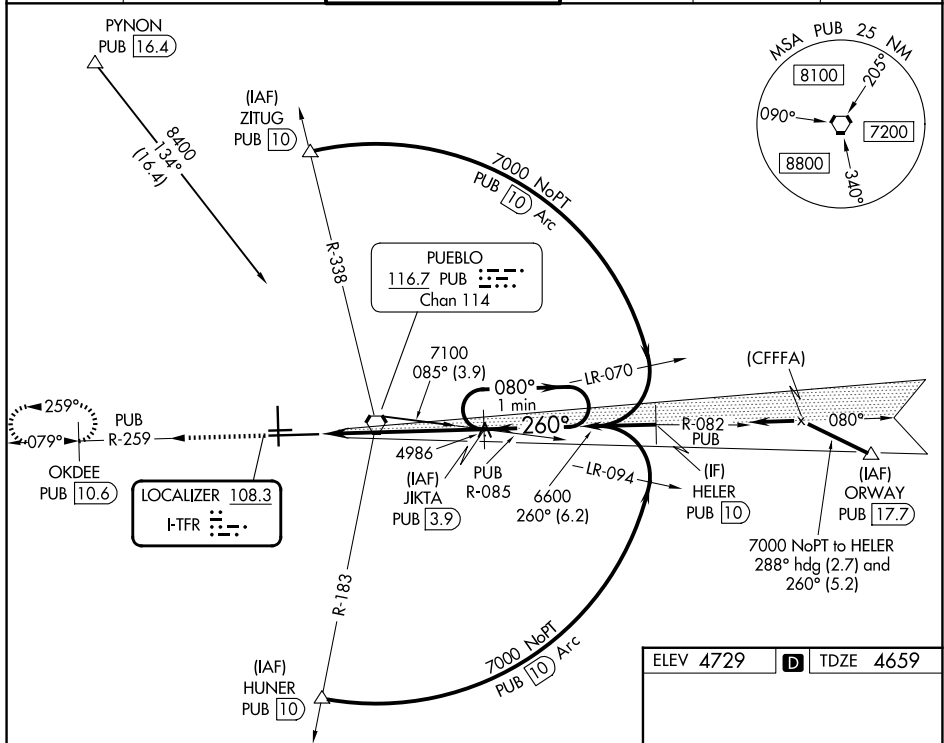

7000
↑
hdg 260°

PUB R-259

OKDEE
PUB 10.6

JIKTA
PUB 3.9

One Minute Holding Pattern

6600

080° →

← 260°

6600

GS 3.00°
TCH 60

260°

PUB VORTAC

PUB 2.1

CATEGORY	A	B	C	D
S-ILS 26L	4859-3/4 200 (200-3/4)			
S-LOC 26L	5160-1 501 (500-1)	5160-13/8 501 (500-1 3/8)		
CIRCLING	5340-1 611 (700-1)	5580-2 1/2 851 (900-2 1/2)	5800-3 1071 (1100-3)	

ELEV 4729	D	TDZE 4659
-----------	----------	-----------

