

LOC/DME I-TLH  
**110.3**  
Chan **40**

APP CRS  
**004°**

Rwy Idg **7000**  
TDZE **62**  
Apt Elev **83**

ILS Z or LOC Z RWY 36  
TALLAHASSEE INTL (TLH)

DME required. RADAR required for procedure entry at CVILL.

ASR

\* RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR

MISSED APPROACH: Climb to 4000 direct SZW VORTAC and hold, continue climb-in-hold to 4000.

ATIS  
**119.45 239.25**


TALLAHASSEE APP CON \*  
**135.8 317.4**

TALLAHASSEE TOWER \*  
**118.7 (CTAF) 0 257.8**

GND CON  
**121.9 348.6**

CLNC DEL  
**126.65 275.8**

UNICOM  
**123.075**

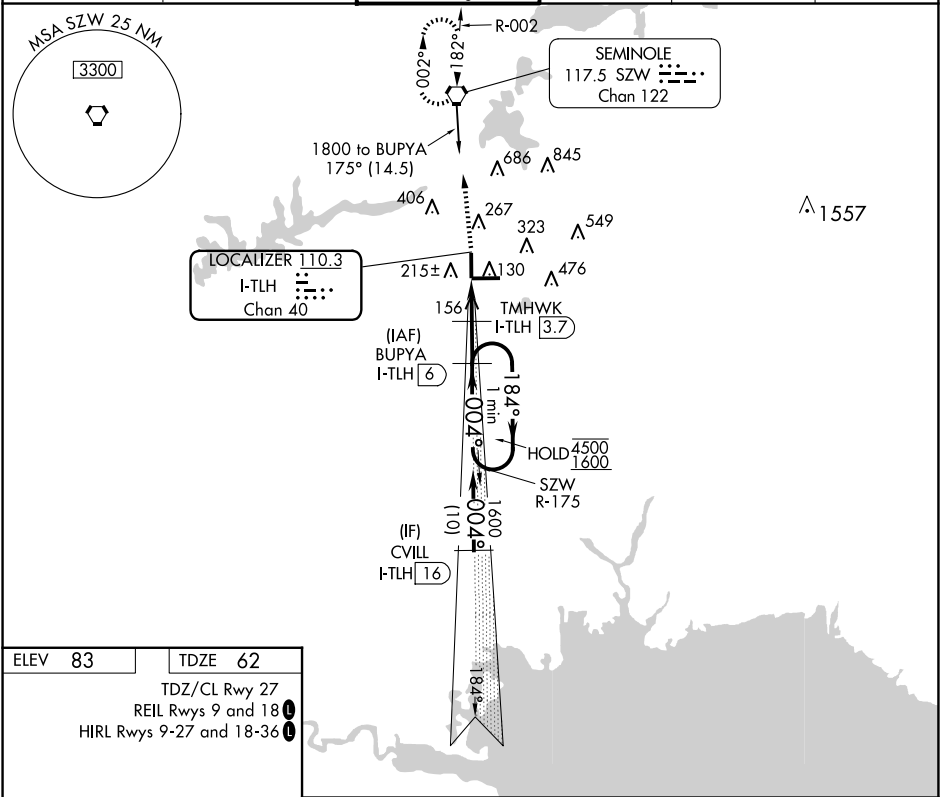

ELEV **83**

TDZE **62**

TDZ/CL Rwy 27  
REIL Rwy 9 and 18  
HIRL Rwy 9-27 and 18-36

4000 SZW

One Minute Holding Pattern

TMHVK I-TLH **3.7**

BUPLYA I-TLH **6**

184° → 4500  
← 004° 1600

GS 3.00°  
TCH 54

2.4 NM 2.3 NM

CATEGORY	A	B	C	D
S-ILS 36 *	262/24		200 (200-½)	
S-LOC 36	460/24	398 (400-½)	460/35	398 (400-¾)
CIRCLING	580-1 497 (500-1)	600-1 517 (600-1)	640-1½ 557 (600-1½)	800-2¼ 717 (800-2¼)