

APP CRS
137°

Rwy Ldg **7701**
TDZE **27**
Apt Elev **29**

RNAV (RNP) Y RWY 14

JACKSONVILLE INTL (JAX)


▼

For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required. For inoperative MALSR, increase RNP 0.30 all Cats
visibility to 1½ mile.

MALSR

MISSED APPROACH: Climb to 500 then climbing left turn to 2000 direct YEJWO and hold.

D-ATIS 125.85	JACKSONVILLE APP CON 119.0 269.9	JACKSONVILLE TOWER 118.3 317.7	GND CON 121.9 348.6	CLNC DEL 119.5 290.275	CPDLC
-------------------------	--	--	-------------------------------	----------------------------------	-------

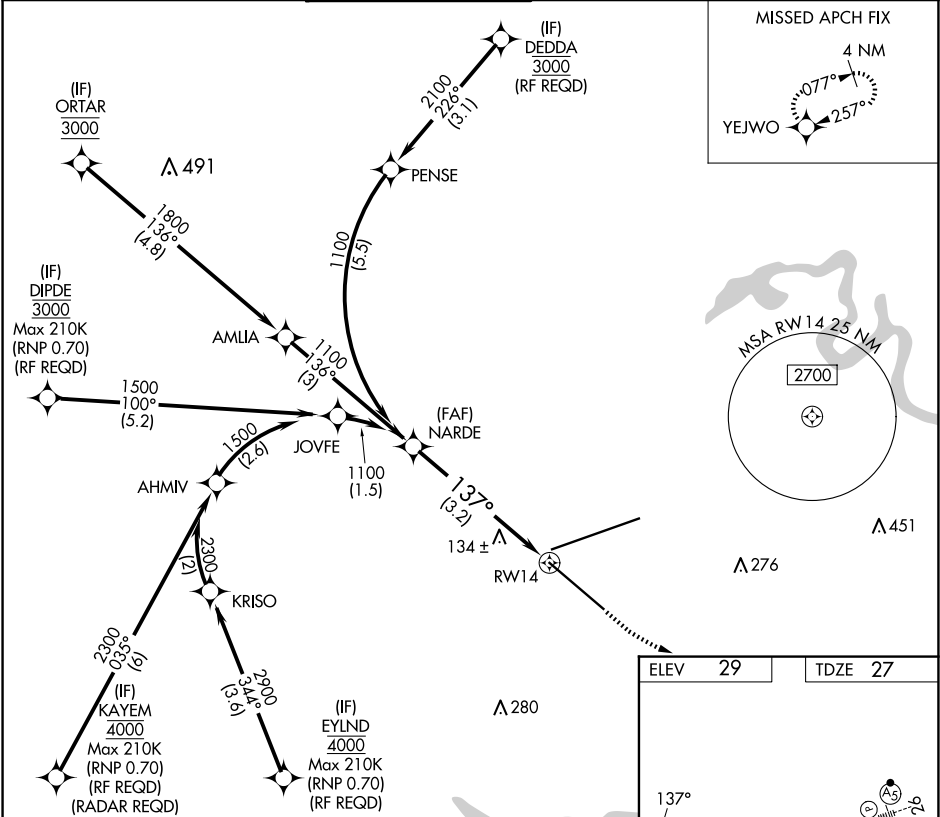

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

500

2000

YEJWO

1100

GP 3.00°
TCH 54

137°

See planview for multiple IF locations.

RW14

3.2 NM

CATEGORY	A	B	C	D
RNP 0.30 DA	389-1 362 (400-1)			

AUTHORIZATION REQUIRED

JACKSONVILLE, FLORIDA

Orig-B 30APR15

JACKSONVILLE INTL (JAX)

30°30'N-81°41'W

RNAV (RNP) Y RWY 14

ELEV 29

TDZE 27

REIL Rwy 32

TDZ/CL Rwys 8, 14, and 26

HIRL Rwys 8-26 and 14-32

SE-3, 07 AUG 2025 to 04 SEP 2025

SE-3, 07 AUG 2025 to 04 SEP 2025